


GUARD POST DETAIL

NOT TO SCALE

UNOBSTRUCTED ACCESS ROADWAY

NOT TO SCALE

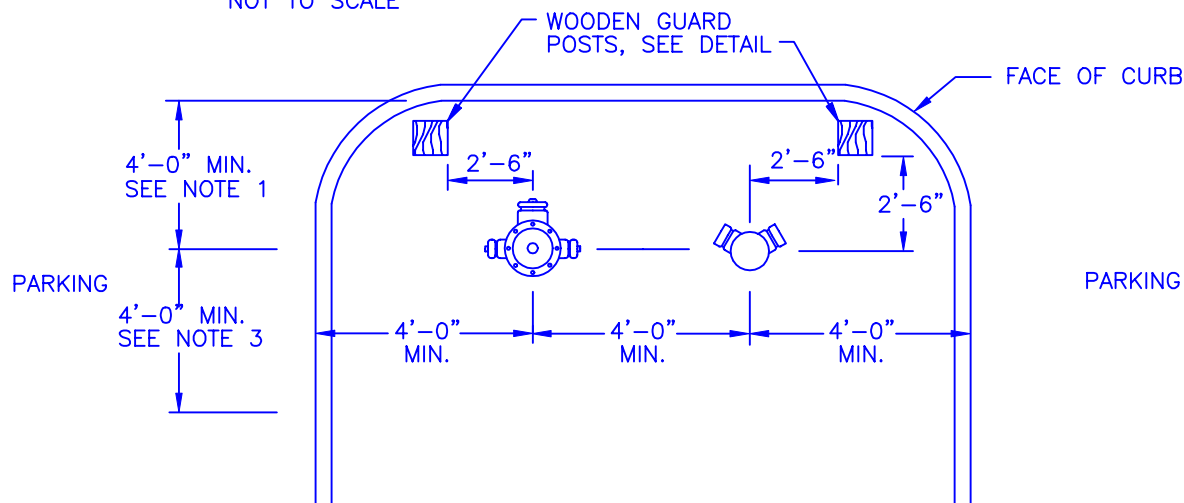

UNOBSTRUCTED ACCESS ROADWAY

NOTES:

NOT TO SCALE

1. GUARD POSTS ARE REQUIRED IF HYDRANT AND/OR FIRE DEPARTMENT CONNECTION ARE LESS THAN 4 FEET FROM CURB LINE, OR WHEN OTHERWISE DETERMINED NECESSARY BY THE FIRE MARSHAL OR WATER DEPARTMENT.
2. ONLY GROUND COVER LANDSCAPING SHALL BE PLANTED WITHIN DIMENSIONED AREAS.
3. A 4'-0" MINIMUM AREA SHALL BE FREE FROM PLANTS OR SHRUBS OR OTHER OBSTRUCTIONS.
4. A 8'-0" MINIMUM AREA SHALL BE FREE FROM TREES.

APPROVED: SCOTT THOMASSON
REV. DATE: FEB. 1, 1997

WATER/WASTEWATER DIVISION



STANDARD DETAILS

FIRE HYDRANT AND STANDPIPE LOCATION

FILE SD712.DWG DRAWING NO. **712**